

DATA SHEET

TM 50

Temperature transmitter with Pt100 output on terminal block



Range from 0 to 50 °C
and from -20 to +80 °C




Pt100 2/3 wires
output

- ABS housing, IP65 (air tight model) or IP20 (ambient model) protection
- "1/4 turn" system mounting with wall-mount plate
- Housing with simplified mounting system


Features of the housing

Material	ABS V0 as per UL94 wall housing
Protection index	IP65 Air tight model IP20 Ambient model
Cable gland	For cables Ø8 mm maximum Air tight model
Weight	143 g
Storage temperature	From -20 to +80 °C


Ambient model

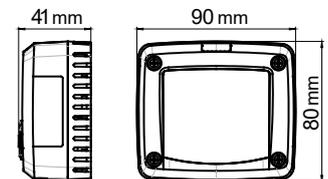

Air tight model

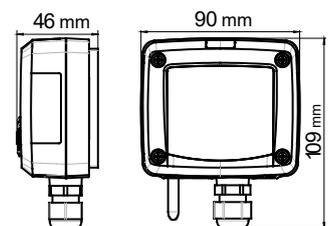

Part number

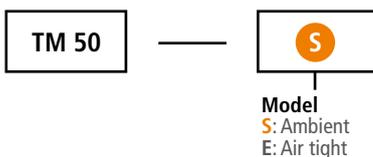

Example: TM 50-S

Ambient temperature transmitter type TM 50-S. ABS wall housing. Pt100 2/3 wires output.

Technical specifications

Operating temperature	From 0 to 50 °C (ambient model), from -20 to +80 °C (air tight model)
Accuracy ⁽¹⁾	Pt100
Type of sensor	Pt100 Class A
Contact tip (air tight model)	Stainless steel 316L
Environment	Air and neutral gases

⁽¹⁾ All the accuracies indicated in this technical datasheet were stated in laboratory conditions, and can be guaranteed for measurements carried out in the same conditions, or carried out with calibration compensation.

Symbols used

For your safety and in order to avoid any damage of the device, please follow the procedure described in this document and read carefully the notes preceded by the following symbol:




The following symbol will also be used in this document, please read carefully the information notes indicated after this symbol:




Useful information on thermometry with platinum RESISTOR Pt100

2-wire mounting



This is the simplest way, but line resistors (RL1 and RL2) are connected to the sensor in a series circuit. The addition of RL1 + RL2, leads to an off-set between measured temperature and real temperature. This connection must be avoided.

3-wire mounting



This connection involves identical line resistors (RL1-RL2-RL3), RL2 + RL3 allow you to measure the line resistance that will be subtracted from the measured resistance between 1 and 2-2' terminals. This is the most common connection.

Tolerance of Pt100 probes as per IEC 60751 (2008) standard

Temperature	Tolerance Class A	
	±°C	±°Ohms
-50 °C	0.25	0.1
0 °C	0.15	0.06
100 °C	0.35	0.13

Maintenance: please avoid any aggressive solvent. Please protect the transmitter and its probes from any cleaning product containing formalin, that may be used for cleaning rooms or ducts.


Accessories

DIN Rail Converters



Only the accessories supplied with the device must be used.


Connections

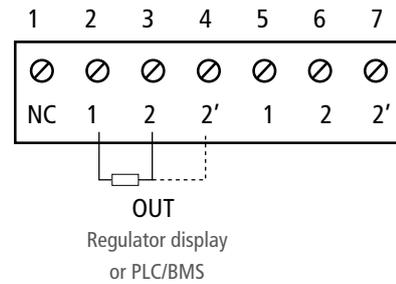

Mounting

To mount the transmitter, mount the ABS plate on the wall (drilling: Ø 6 mm, screws and pins are supplied). Insert the transmitter on the fixing plate (see A on the drawing beside). Rotate the housing in clockwise direction until you hear a "click" which confirms that the transmitter is correctly installed.

! Ambient model has not any fixing plate. 4 fixing holes are inside the back housing. Use them to install the transmitter on the required location. The contact model is fixed with 2 mounting brackets supplied with the transmitter.

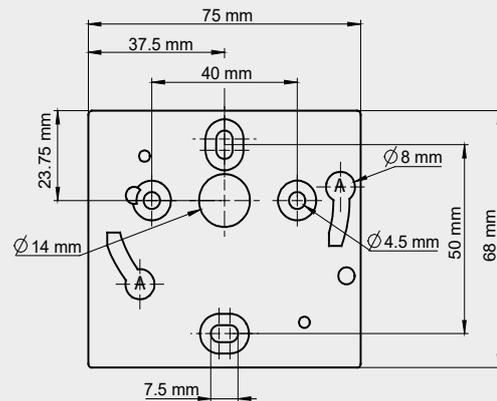

Precautions for use: please always use the device in accordance with its intended use and within parameters described in the technical features in order not to compromise the protection ensured by the device.

Warranty

Instruments have 1-year guarantee for any manufacturing defect.